

**CAUTION**

This fixture must be installed and wired by a licensed electrician.


JLC-Tech LLC will not be held responsible if the fixtures are not installed according to applicable codes and safety standards

Installation is subject to local code and jurisdiction

Keep these instructions for the person responsible for the maintenance of this installation.

Purple/Grey to 0-10VDC
Dimming System

Line Voltage
Connections

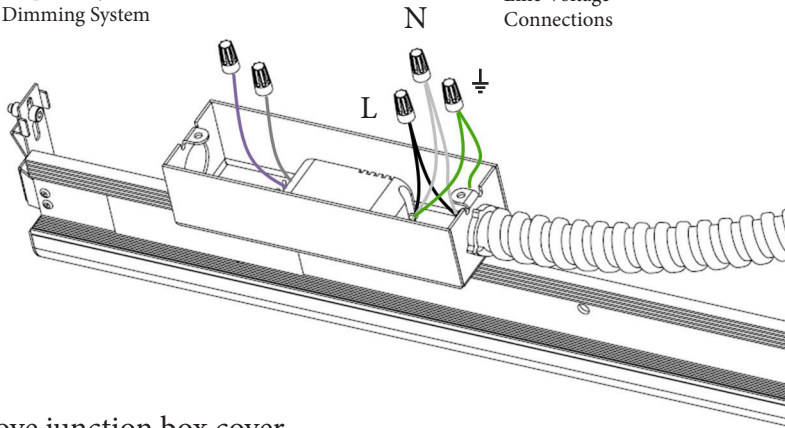

Remove junction box cover
and make wiring connections to line
voltage and dimming system (if needed).
Replace cover when complete.

Electrical Ratings

Input Voltage: 120-277V, 50/60Hz


	Amps	Watts
TBECOH - 2ft	0.08	9.5
TBECOH - 4ft	0.16	17.9
TBECOL - 2ft	0.06	6.4
TBECOL - 4ft	0.11	12.5

ETL Listed for Indoor Use

ATTENTION: READ ALL INSTRUCTIONS ENTIRELY BEFORE INSTALLATION

ATTENTION: READ ALL INSTRUCTIONS ENTIRELY BEFORE INSTALLATION

THE NEXT
GENERATION GREEN
LIGHTING SOLUTION
FOR SUSPENDED
CEILING APPLICATIONS

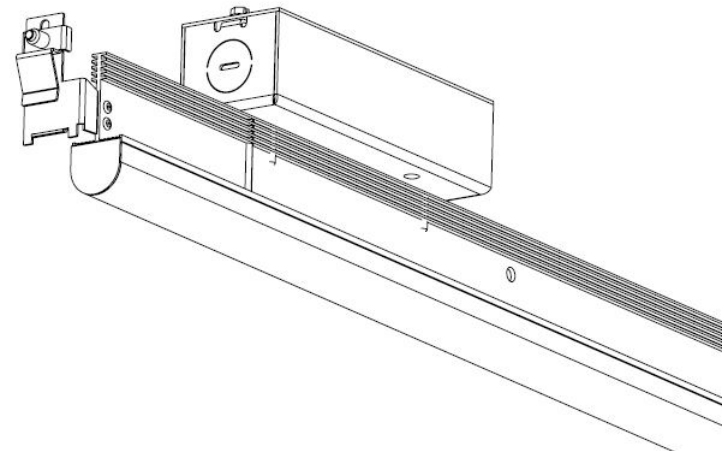

SPECIFICALLY DESIGNED
FOR 15/16" (T24) GRID



RoHS


CODE: T-BAR345 T-BAR ECO Universal Instruction Sheet 15/16"

The T-BAR LED product line is protected under the following patents:
Patent No. 8,177,385; 9,879,850; 004481000-0001; 004481000-0002.
Additional patents are pending.

MADE IN USA


WHERE I CAN INSTALL THE T-BAR ECO™

- IN A NEW CEILING INSTALLATION 15/16" (T24) GRID, ORGANIZE THE PLOT TO HAVE A 2'x4' (60x120cm), OR 4'x4' (120x120cm) SPACES WHERE THE 2' OR 4' T-BAR ECO™ WILL BE INSTALLED (ACCORDING TO THE LIGHT REQUIREMENT)
- INSTALL THE T-BAR ECO™ AT THE CENTER OF THE SPACE, CREATING TWO SECTIONS OF 2'x2' (60x60cm) OR 2'x4' (60x120cm) EACH, DEPENDING IF USING A 2' OR 4' T-BAR ECO™

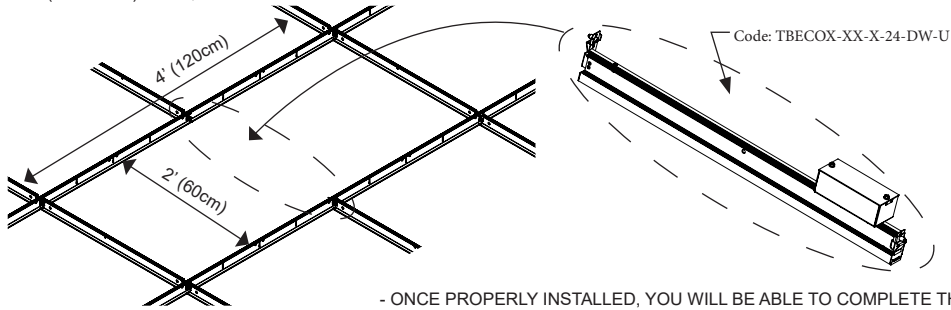


- ONCE PROPERLY INSTALLED, YOU WILL BE ABLE TO COMPLETE THE CEILING WITH 2'x2' (60x60cm) OR 2'x4' (60x120cm) TILES

- IN AN EXISTING SUSPENDED CEILING 15/16" (T24), LOCATE THE 2' (60cm) OR 4' (120cm) CROSS TEES THAT ARE INTENDED TO BE SUBSTITUTED WITH THE 2' (60cm) OR 4' (120cm) T-BAR ECO™ (ACCORDING TO THE LIGHT REQUIREMENT)
- TEMPORARILY REMOVE THE TILES WITHIN THE SPACE YOU SELECTED
- REMOVE THE 2' (60cm) OR 4' (120cm) CROSS TEE AND REPLACE IT WITH THE 2' (60cm) OR 4' (120cm) T-BAR ECO™
- ONCE PROPERLY INSTALLED, PLACE THE 2'x2' (60x60cm) OR 2'x4' (60x120cm) TILES BACK

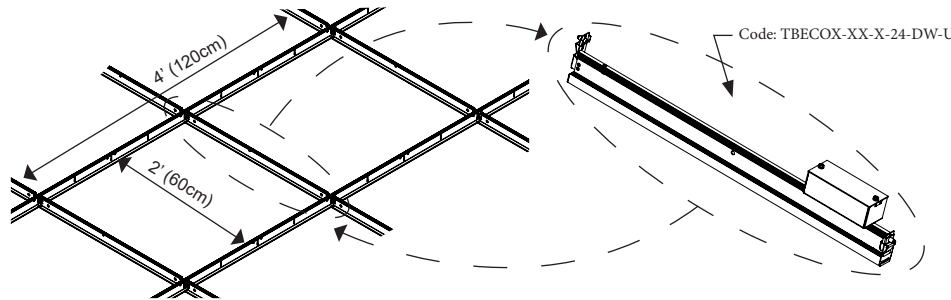


NOTE: MAKE SURE THAT THE T-BAR ECO™ IS POSITIONED TO ALLOW THE CORRECT PLACING OF THE CORRESPONDENT TILES


T-BAR ECO™ MUST BE ANCHORED TO THE ABOVE BUILDING STRUCTURE WITH A STEEL CABLE USING THE CENTER HOLE. (STEEL CABLE BY OTHERS)

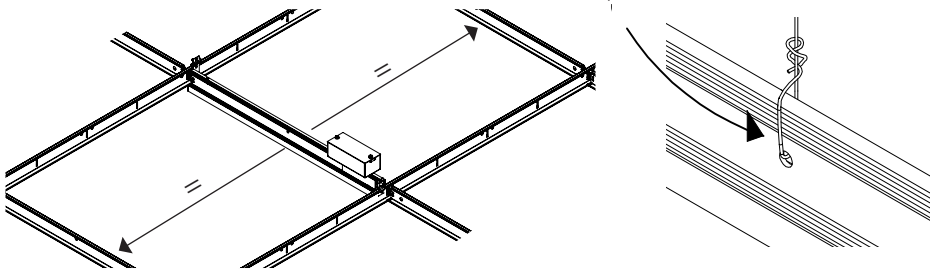**HOW I INSTALL THE T-BAR ECO™**


- PLACE THE PRODUCT OVER THE GRID FOLLOWING THE BELOW CONFIGURATION.
- MAKE SURE THAT THE UPPER PLANE OF THE T-BAR ECO™ IS AT THE SAME PLANE WITH THE UPPER PLANE OF THE GRID AS SHOWN IN DETAIL "A".

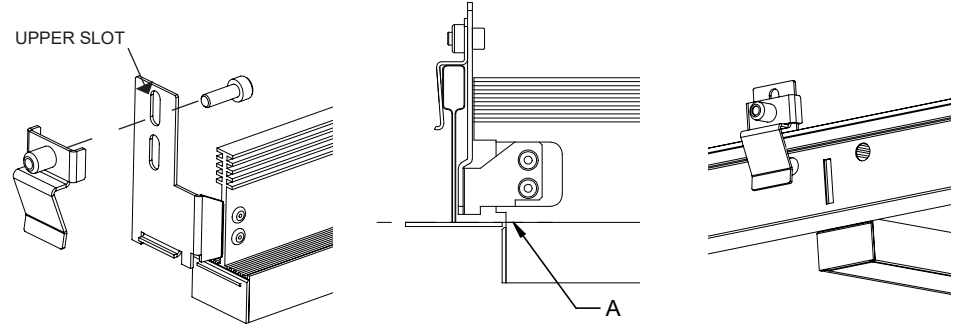

NOTE: THE SLOTS ON THE MOUNTING BRACKET ARE DESIGNED TO ACCOMODATE DIFFERENT GRID HEIGHTS

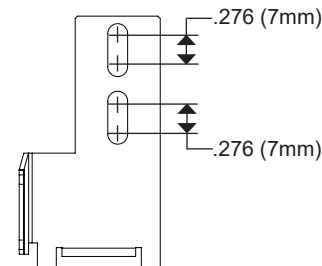

ONCE THE PRODUCT IS POSITIONED, TIGHTEN THE SCREW ON EACH END

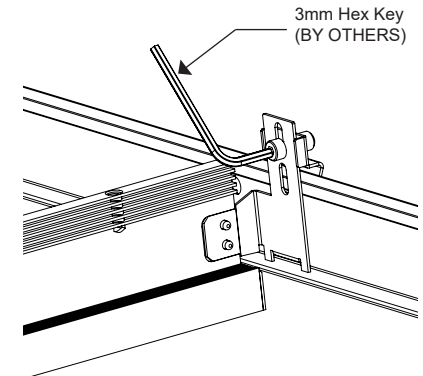

- AFTER YOU HAVE ELECTRIFIED THE SYSTEM (SEE FOLLOWING PAGE FOR INSTRUCTION), YOU CAN INSTALL THE TILES IN THEIR CORRECT POSITION OVER THE T-BAR ECO™ PRODUCT

